


Performance Comparison of different HEPs											UJVNL
Comparison for the month of February 2016											
Name of HEP	Generation in MU	Target in MU	Generation Loss MU	PAFAM in %	NAPAF in % AS specified by UERC	Export in MWh	Import in MWh	Transformation Loss in MWh	Aux Consumption in MWh	Aux Consumption+ Transformation Loss	Forced Outage in Hrs
Chibro	23.35	40.0	0.0	72.78	64.00	23264.00	0.00	86.000	137	223.00	0.00
Khodri	11.664	19.00	0.0	63.68	57.00	63893.68	53126.00	27.960	87.67	115.63	0.00
Dhakrani	3.94	7.00	0.00505	32.51	57.00	3170.77	170.646	-	46.941	46.94	0.41
Dhalipur	6.029	11.00	0.0000	35.2	57.00	6885.12	0.00	44.000	21.38	65.38	0
Kulhal	4.859	8.00	0.00167	57.53	65.00	12954.48	8222.40	90.490	36.032	126.52	0
Tiloth	20.332	23.00	0.0	67.14	79.00	20260.64	920.40	745.000	75.441	820.44	0
Dharasu	36.34	42.00	2.84	43.37	58.79	49260.04	13372.11	6.000	210	216.00	33.28
Chilla	55.107	49.00	0.063	71.65	74.00	55123.20	1199.96	844.000	52	896.00	2.91
Ramganga	67.632	34.00	0.00	49.55	19.00	68739.42	1657.56	3.000	92.77	95.77	0.0
Khatima	9.899	5.00	0.133	36.49	47.00	23260.84	13694.64	49.000	77	126.00	4.2
Pathri	11.471	9.16	0.130	-	-	11232.969	0.461	107.000	56	163.00	1.93
Mohd. Pur	5.172	4.63	0.0092	-	-	6397.8	1317.2	1.120	66.59	67.71	0
Galogi	0.446	0.34	0.0142	-	-	437.3	1.38	-	9.68	9.68	0
Total	256.241	252.13	3.19661			344880.25	93682.759	2003.57	968.504	2972.074	42.73

Chibro	72.78	64.00
Khodri	63.68	57.00
Dhakrani	32.51	57.00
Dhalipur	35.2	57.00

**PAFM v/s NAPAF in the Month of February
2016**

Kulhal	57.53	65.00
Tiloth	67.14	79.00
Dharasu	43.37	58.79
Chilla	71.65	74.00
Ramganga	49.55	19.00
Khatima	36.49	47.00

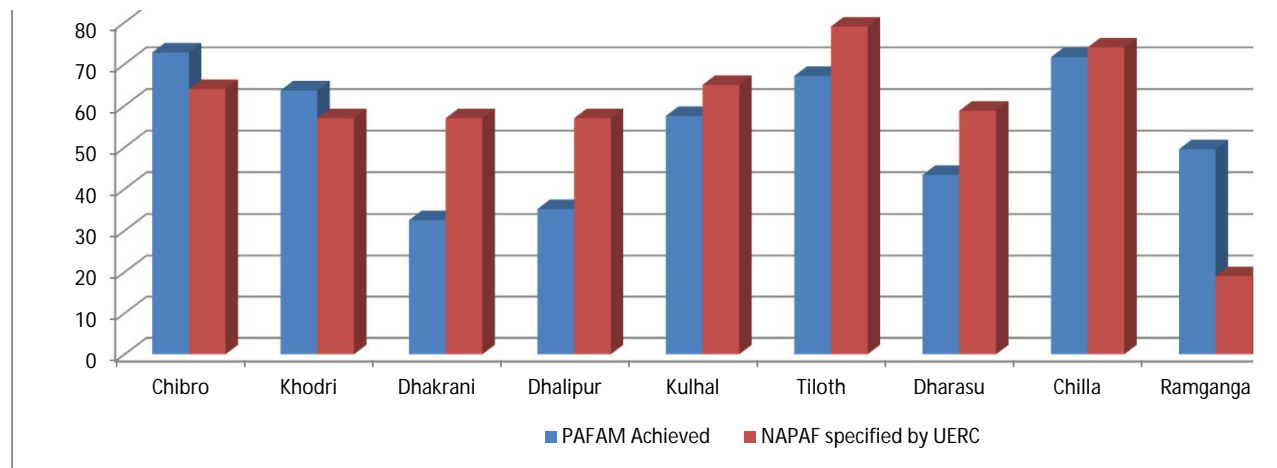

MIS
Date
Remark
-
-
Magnetic Valve Operated in Unit 1
-
-
-
S/D of Plant for Barrage Protection works
Problem in Intake gate of Unit 3
-
Excitation problem in Unit 1, RMU testing works
Cooling water problem
-
-
Oil leakage from OPU & Bearing of Unit 4



